


Compression Fitting

Mechanical fitting system for Flexalen[®] PB service pipes

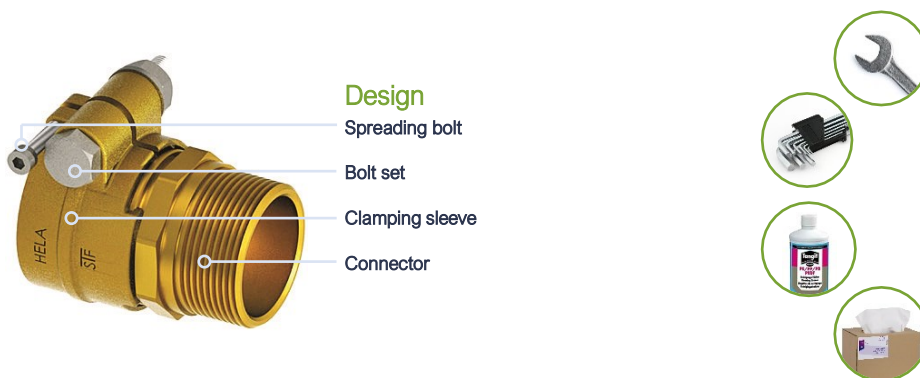

Required Tools

Screw wrench and/or adjustable spanner wrench

Allen key set

Cleaner

Tissues

Application Instruction

Application conditions and pipe preparation

- Ambient temperature: +5 to +40°C
- Service pipe is cut straight and without damage
- Service pipe is free from dirt and condensation




01.
Open the clamping sleeve by using the spreading bolt with an Allen key. Place clamping sleeve on the medium pipe.



02.
Insert the connector into the medium pipe.



03.
Place the clamping sleeve in such a way that the tabs (A) align with the groove on the body.



04.
Start tightening. Tighten periodically and allow the pipe to modify. Ensure that the pipe always stays in the bottom (B).




05.
Tighten the bolt until the clamping sleeve is closed. For fittings > 63mm a gap of 3-7mm is allowed. Retighten the bolts after 30min.



06.
Inspection (after 30 min):
a) If the service pipe is still in place and there is no gap (fittings ≤63mm) or gap of max 7mm (fittings >63mm) the fitting is placed correctly.



b) If there is a gap (fittings ≤63mm) or gap >7mm (fittings >63mm) let the compression fitting "rest" for 24 hours. Retighten the bolt again after 24 hours.



07.
Start pressure testing according DIN:1988-2.

Note: Check and retighten compressing fitting again before insulating.

Disclaimer

All recommendations and information provided on this data sheet are based on our knowledge and experience. Product specifications are intended as guidelines. Since conditions of service are beyond our control, users must satisfy themselves that products are suitable for the intended use. No guarantee or warranty is given or implied or that any use of products will not infringe rights belonging to other parties. We reserve the right to change product design and properties without notification.